

# How to operate Configurator?



- Installation
- Sign-in
- Order details
- Product Configuration
- Export Data
- E-mail

To get Rishabh Configurator software visit the below link

<http://configurator.rishabh.co.in/Index.html>

- Follow the below steps to setup the Product Configurator
- Click on “Download” to download the setup i.e Rishabh.zip file
- After completion of download process unzip the folder to proceed ahead
- Install the Access engine “AccessDatabaseEngine” for Win 32 bits and “AccessDatabaseEngine\_x64.exe” for Win 64bits
- Install dotnet 3.5“dotnetfx35.exe”
- Open the folder “DISK1” and double click on “Rishabh.exe”
- Go ahead with configurator








Download


Download software for pc.

[Download](#)

[View details »](#)

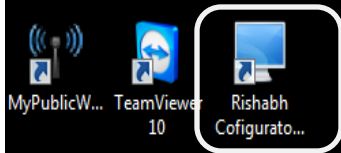

After completion of installation process click on auto generated desktop icon **“Rishabh Configurator”**

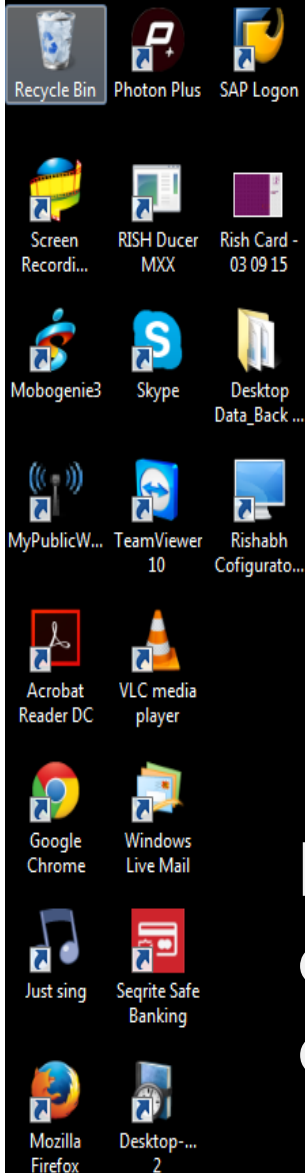

Enter **“User ID”** and **“Password”**, and click on button **“Sign in”** to proceed ahead

Order Details

Customer PO Ref. No.

Customer PO Date 30/09/2015

Date of Order 30/09/2015

Required Delivery Date 30/09/2015

Order Type

Contact Person

Mob. No.

Landline No.

End Customer Details

Consignee Name Address



Select Product

Product Category

Model

Description

Add to Cart

Product Code	Description	Qty	MRP	Discount (%)	Value	Special Instructions	Customer Item Tef. Code	Required Date (D/M/Y)
<p>Here you can see the initial screen for the “Rishabh configurator”</p>								

Export Data

Total :

Order Details		Order Type		End Customer Details		Consignee Name _Address	
Customer PO Ref. No.	RIPL_NSK_001	Order Type	Customer	Trishala Unit - R&D + Marketing Rishabh Instruments Pvt. Ltd. C-6, NICE area, Satpur Nashik - 422005 Maharashtra India 91-253 2202202/203 Fax: 91 253 2351064		Rishabh Instruments Pvt. Ltd. F-31, MIDC, Satpur Nashik - 422007 Maharashtra India 91-253 2202202/203 Fax: 91 253 2351064	
Customer PO Date	30/09/2015	Contact Person	Sachin Rajole				
Date of Order	30/09/2015	Mob. No.	9765838500				
Required Delivery Date	15/10/2015	Landline No.	0253-22022072				



Enter Order reference  
**PO No.**  
**PO date**  
**Date of order**  
**Required Delivery date**




Select Order type with help  
of "**Drop down**"

Enter Contact details  
**Contact person**  
**Mobile No**  
**Landline No**



Enter Customer Details  
**Name of Company**  
**Address**  
**(Bill-to-party)**

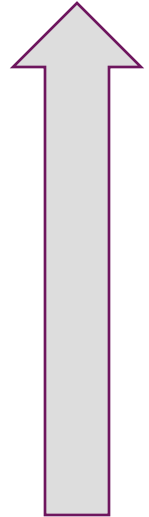

Enter Consignee Details  
**Name of Company**  
**Address**  
**(Ship-to-party)**

Order Details

Customer PO Ref. No.	<input type="text" value="RIPL_NSK_001"/>	Order Type	<input type="text" value="Stock"/>	End Customer Details	Consignee Name Address
Customer PO Date	<input type="text" value="30/09/2015"/>	Contact Person	<input type="text" value="Sachin Rajole"/>	Trishala Unit - R&D + Marketing Rishabh Instruments Pvt. Ltd. C-6, NICE area, Satpur Nashik - 422005 Maharashtra India 91-253 2202202/203 Fax: 91 253 2351064	Rishabh Instruments Pvt. Ltd. F-31, MIDC, Satpur Nashik - 422007 Maharashtra India 91-253 2202202/203 Fax: 91 253 2351064
Date of Order	<input type="text" value="30/09/2015"/>	Mob. No.	<input type="text" value="9765838500"/>		
Required Delivery Date	<input type="text" value="15/10/2015"/>	Landline No.	<input type="text" value="0253-22022072"/>		



Select Product

Product Category

- 
- Analog Panel Meter
- CAM Switch
- Clamp Meter
- Current Transformer
- Digital Multimeter
- Digital Panel Meter
- Digital Protection Relay
- Electrical Transducer**
- Insulation Tester
- Multifunction Meter
- Power Quality Analyser
- Power Supply
- Protector Relay
- Shunt
- Signal Isolator
- Temperature Controller

Add to Cart

Select Product category with help of "Drop Down"

Product Code	Description	Qty	MRP	Discount (%)	Value	Special Instructions	Customer Item Tef. Code	Required Date (D/M/Y)

Export Data

Total :

Order Details

Customer PO Ref. No.

Customer PO Date

Date of Order

Required Delivery Date

Order Type

Contact Person

Mob. No.

Landline No.

End Customer Details

Trishala Unit - R&D + Marketing  
Rishabh Instruments Pvt. Ltd.  
C-6, NICE area, Satpur  
Nashik - 422005  
Maharashtra India  
91-253 2202202/203 Fax: 91 253 2351064

Consignee Name Address

Rishabh Instruments Pvt. Ltd.  
F-31, MIDC, Satpur  
Nashik - 422007  
Maharashtra India  
91-253 2202202/203 Fax: 91 253 2351064



Select Product

Product Category

Model

- Current Transducer I11 - Self Powered
- Current Transducer I22 - True RMS
- PF / Phase Angle Transducer C11 - 1
- PF / Phase Angle Transducer C11 - 2
- Phase Angle Difference Transducer C
- Power Transducer - Active, 1Phase 2
- Power Transducer - Active, 1Phase 2
- Power Transducer - Active, 3Phase 3
- Power Transducer - Active, 3Phase 3
- Power Transducer - Active, 3Phase 3
- Power Transducer - Active, 3Phase 3
- Power Transducer - Active, 3Phase 4
- Power Transducer - Active, 3Phase 4
- Power Transducer - Re-Active, 1Phas
- Power Transducer - Re-Active, 1Phas
- Power Transducer - Re-Active, 3Phas
- Power Transducer - Re-Active, 3Phas
- Power Transducer - Re-Active, 3Phas
- Power Transducer - Re-Active, 3Phas
- Power Transducer - Re-Active, 3Phas
- Power Transducer - Re-Active, 3Phas
- Programmable Current / Voltage Trans
- Programmable Frequency Transducer
- Programmable Multi-function Transduc
- Programmable Power Transducer - Ris
- Voltage Transducer E13 - 3 I/P, 3 O/F
- Voltage Transducer E15 - 1 I/P, 1 O/F
- Voltage Transducer E15 - 1 I/P, 2 O/F
- Voltage Transducer V11 - Self Power
- Voltage Transducer V22 - True RMS

Add to Cart



Select Model with help of  
**"Drop Down"**

Product Code	Description	Qty	MRP	Discount (%)	Value	Special Instructions	Customer Item Tef. Code	Required Date (D/M/Y)

Export Data

Total:12712

Order Details

Customer PO Ref. No.

Customer PO Date

Date of Order

Required Delivery Date

Order Type

Contact Person

Mob. No.

Landline No.

End Customer Details

Consignee Name ,Address



Select Product

Product Category

Model

Description

Product Type

Auxiliary Power Supply

Customer Specific Requirement

Add to Cart

Product Code	Description	Qty	MRP	Discount (%)	Value	Special Instructions	Customer Item Tef. Code	Required Date (D/M/Y)

← Click on button "Add to Cart"

Export Data

Total:12712

Order Details

Customer PO Ref. No.

Customer PO Date 30/09/2015

Date of Order 30/09/2015

Required Delivery Date 30/09/2015

Order Type Stock

Contact Person Sachin Rajole

Mob. No. 9765838500

Landline No. 0253-22022072

End Customer Details

Trishala Unit - R&D + Marketing  
Rishabh Instruments Pvt. Ltd.  
C-6, NICE area, Satpur  
Nashik - 422005  
Maharashtra India  
91-253 2202202/203 Fax: 91 253 2351064

Consignee Name Address

Rishabh Instruments Pvt. Ltd.  
F-31, MIDC, Satpur  
Nashik - 422007  
Maharashtra India  
91-253 2202202/203 Fax: 91 253 2351064



Select Product

Product Category  
Analog Panel Meter

Model  
Elapsed Time Meter (72)

Description

Input Voltage  
100-125V AC

Frequency  
50Hz

Accuracy  
Not applicable

Suppression  
NA

Front Facia  
Normal glass

Ingress Protection  
IP 52 case

Cover  
NA

Type of dial  
Standard Aluminum

Background  
Not applicable

Add to Cart

	Product Code	Description	Qty	MRP	Discount (%)	Value	Special Instructions	Customer Item Tef. Code	Required Date (D/M/Y)
/	PM11-1J00000000000	Electrical Transducer, Programmable ...	20	18160	30	254240	PTR: 11kV / 110...	ABB-001-22	25/10/2015]



Enter Quantity – Qty

MRP and Standard discount will automatically appear if not, then please contact to Respective sales engineer

Enter Special Instructions like CTR, PTR, Scale / Measuring Range etc.

Enter required item-wise delivery dates only if different from the header level delivery date.

Export Data

Total: 254240

Order Details

Customer PO Ref. No.

Customer PO Date

Date of Order

Required Delivery Date

Order Type

Contact Person

Mob. No.

Landline No.

End Customer Details

Trishala Unit - R&D + Marketing  
Rishabh Instruments Pvt. Ltd.  
C-6, NICE area, Satpur  
Nashik - 422005  
Maharashtra India  
91-253 2202202/203 Fax: 91 253 2351064

Consignee Name ,Address

Rishabh Instruments Pvt. Ltd.  
F-31, MIDC, Satpur  
Nashik - 422007  
Maharashtra India  
91-253 2202202/203 Fax: 91 253 2351064



Select Product

Product Category

Model

Description

Input Voltage

Frequency

Accuracy

Suppression

Front Facia

Ingress Protection

Cover

Type of dial

Background

Add to Cart

Product Code	Description	Qty	MRP	Discount (%)	Value	Special Instructions	Customer Item Tef. Code	Required Date (D/M/Y)
PM11-1J000000...	Electrical Transducer, Programmable ...	20	18160	30	254240	PTR : 11kV / 11...	ABB-001-22	25/10/2015
MM10-1N2Z000...	Digital Multimeter, DMM Max series, M...	5	2115	30	7402			25/10/2015
IT50-1NS000000...	Insulation Tester, Insu 5000 A/AK/M/...	10	41305	30	289135			25/10/2015
YN01-29751WLD...	Shunt, SHUNT, 1000A, 75mV, Class - ...	105	1790	30	131565	1000A/75mV		15/10/2015
PI02-H00000000...	Signal Isolator, Programmable DC Isola...	25	2990	30	52325			20/10/2015
CM22-A69G5500...	Electrical Transducer, Current / Voltag...	28	2450	30	48020		ABB-002-I2	19/10/2015

Now the order is complete click on button **“Export Data”** to proceed ahead



Total:782687

To,

## Rishabh Instruments Pvt. Ltd.



F-31, MIDC Satpur, Nashik - 422007, India  
 Tel. No.: +91 235 2202202, Email: info@rishabh.co.in, Visit: www.rishabh.co.in


### Order Booking Form


Customer PO Ref No:	RIPL_NSK_001	Customer PO Date:	30-09-2015
Date Of Order:	30-09-2015	Required Delivery Date:	15-10-2015
Order Type:	Stock	Contact Person:	Sachin Rajole
Mob No:	9765838500	Fax:	0253-22022072
Customer:	Trishala Unit - R&D + Marketing Rishabh Instruments Pvt. Ltd.  C-6, NICE area, Satpur Nashik - 422005 Maharashtra India 91-253 2202202/203 Fax: 91 253 2351064	Consignee:	Rishabh Instruments Pvt. Ltd. F-31, MIDC, Satpur Nashik - 422007 Maharashtra India 91-253 2202202/203 Fax: 91 253 2351064

Product Code	Description	Qty	MRP	Discount (%)	Value	Special Instructions	Customer Code	Required Date
PM11-11000000000000	Electrical Transducer, Programmable Multi-function Transducer, M42, 85...230V AC / DC, Standard,	20	18160	30	254240	PTR : 11kV / 110V, CTR: 2000/1A	ABB-001-22	25/10/2015
	Digital Multimeter,							

Here you can see the text data which you have entered and selected in the configurator. To complete the order please go through the below steps

1. Use Select All command (Ctrl + A)
2. Copy the data (Ctrl + C)




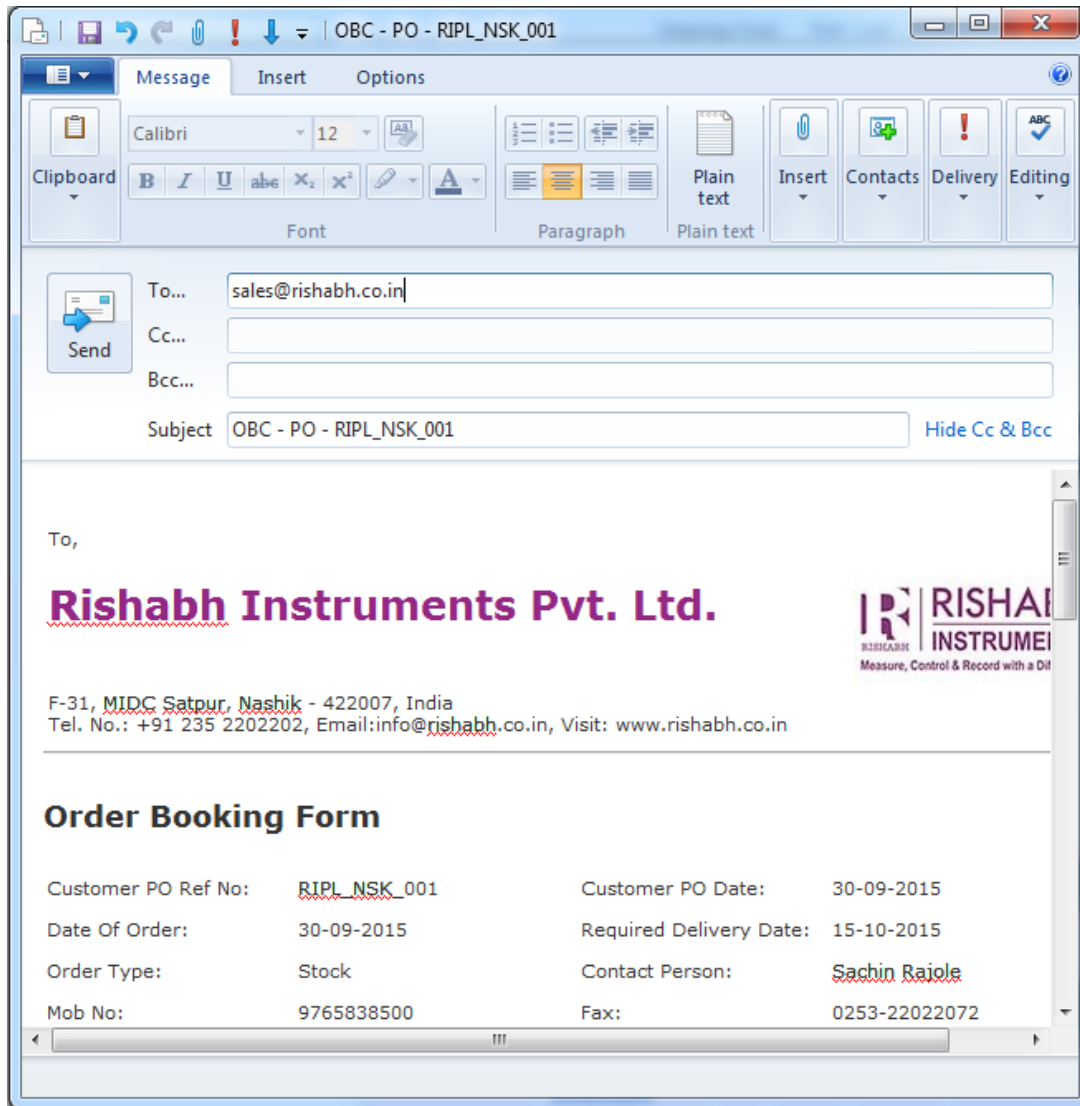

3. Open email client like Outlook or Windows Mail

4. Paste the selected data

5. Send the mail to respective Sales Engineer





**Let's Make Selection Easy.....**